A0 - Do not scale

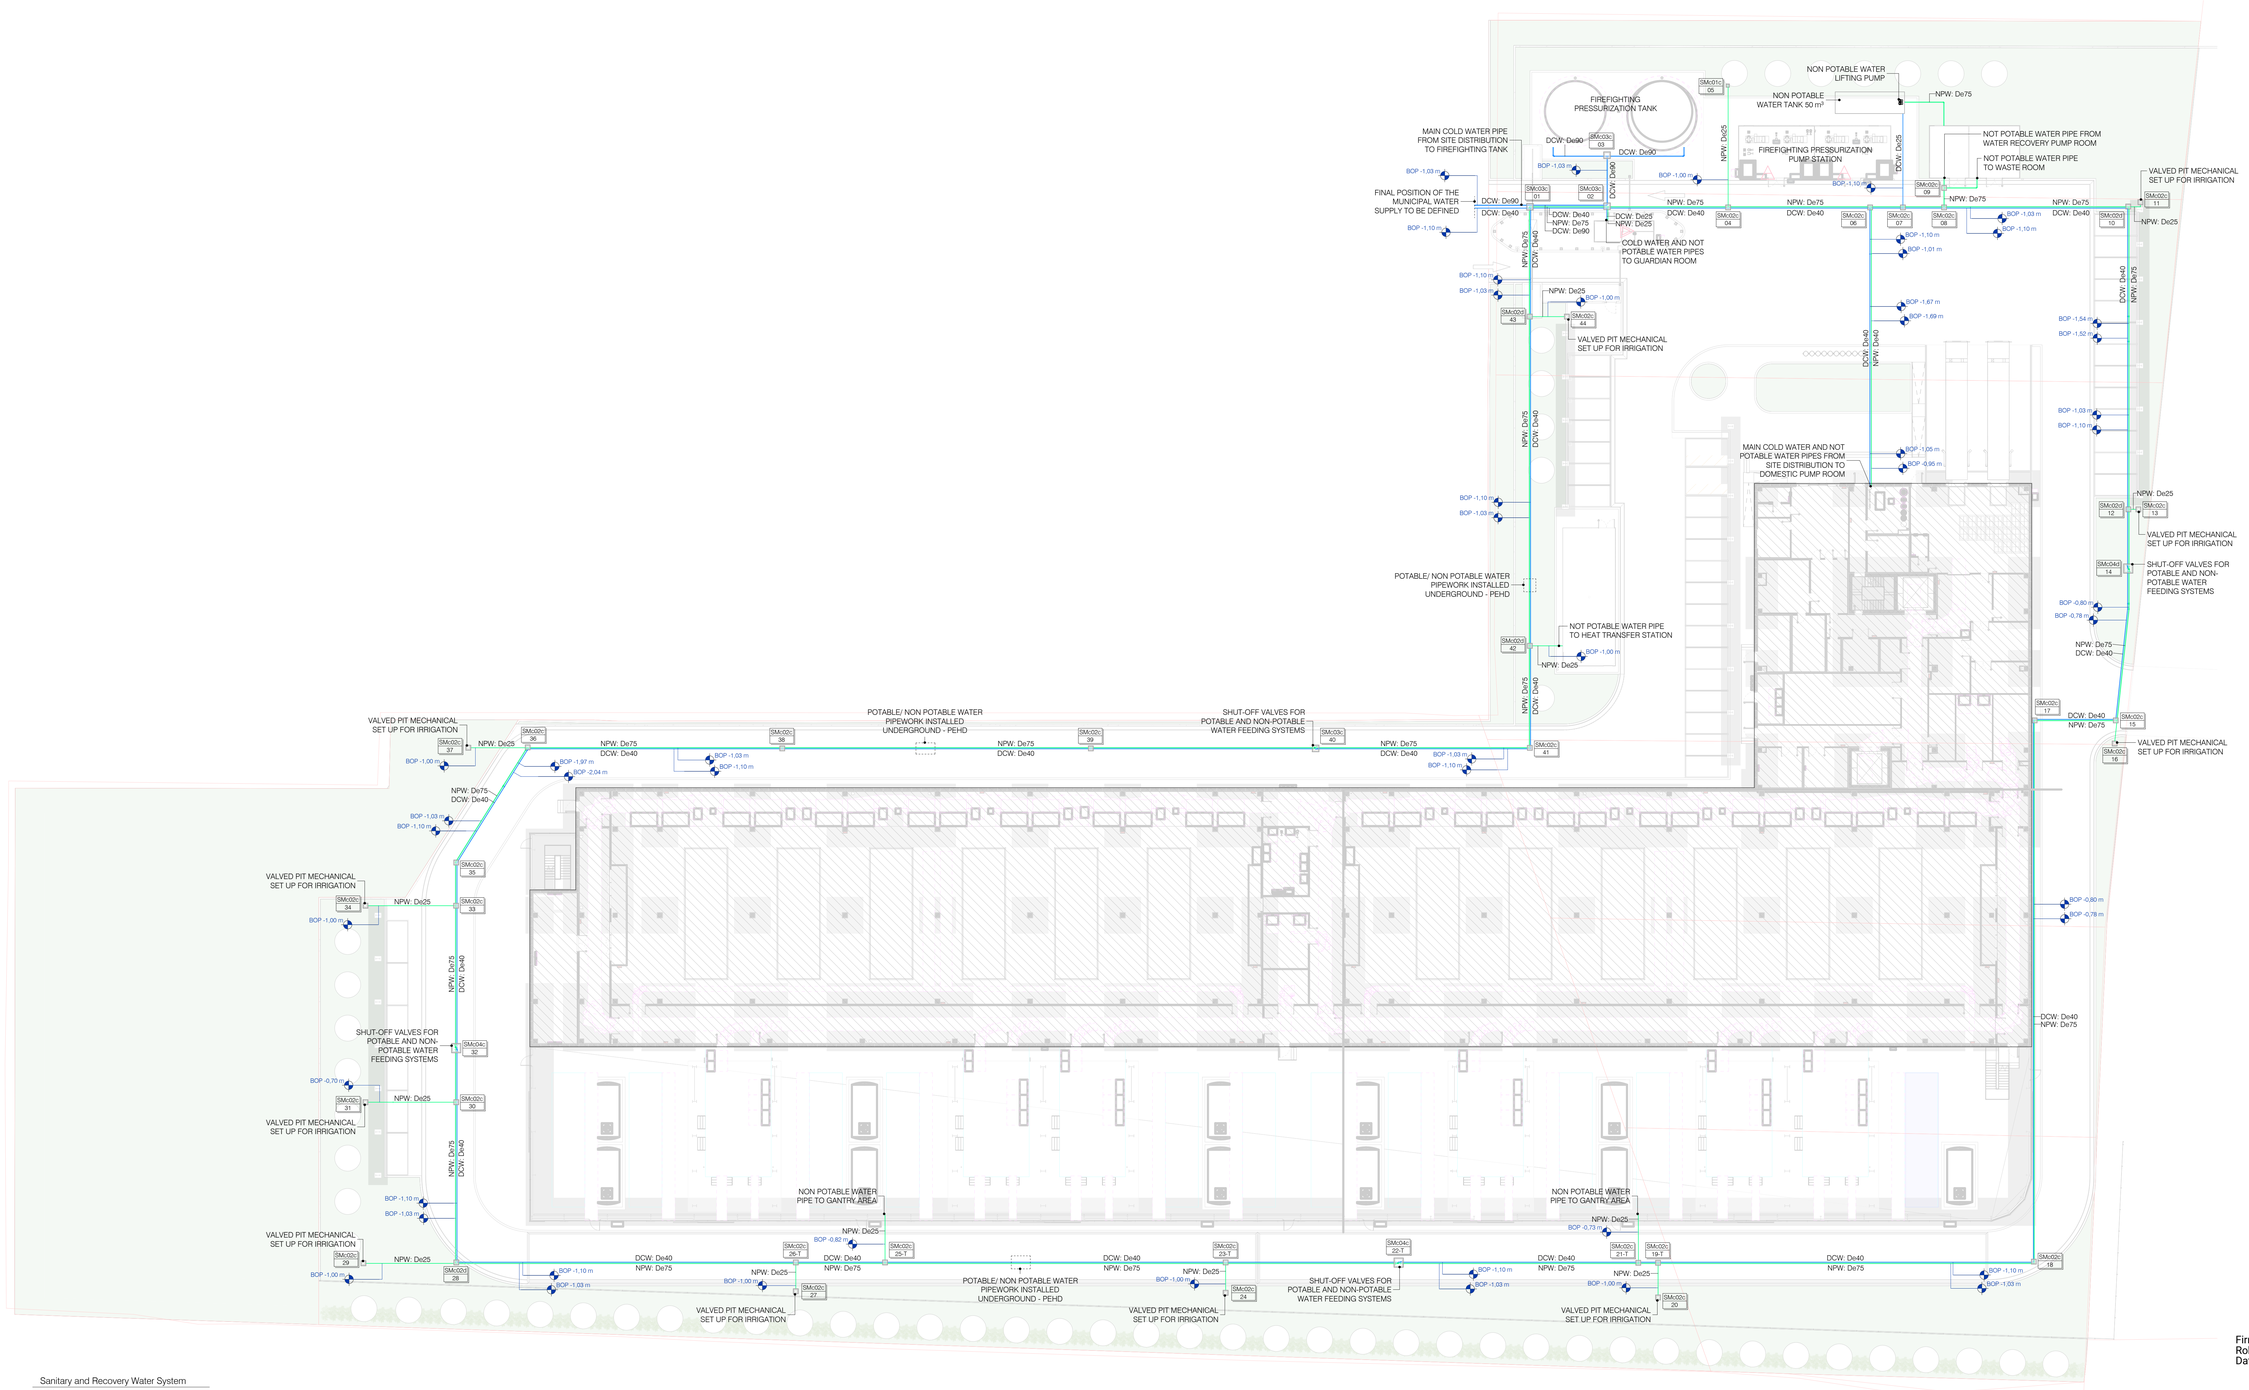
NON POTABLE WATER LIFTING PUMP
NON POTABLE WATER TANK 50 m³
FIREFIGHTING PRESSURIZATION TANK
FIREFIGHTING PRESSURIZATION PUMP STATION
MAIN COLD WATER PIPE FROM SITE DISTRIBUTION TO FIREFIGHTING TANK
FINAL POSITION OF THE MUNICIPAL WATER SUPPLY TO BE DEFINED
NOT POTABLE WATER PIPE FROM WATER RECOVERY PUMP ROOM
NOT POTABLE WATER PIPE TO WASTE ROOM
VALVED PIT MECHANICAL SET UP FOR IRRIGATION
COLD WATER AND NOT POTABLE WATER PIPES TO GUARDIAN ROOM
MAIN COLD WATER AND NOT POTABLE WATER PIPES FROM SITE DISTRIBUTION TO DOMESTIC PUMP ROOM
POTABLE/ NON POTABLE WATER PIPEWORK INSTALLED UNDERGROUND - PEHD
NOT POTABLE WATER PIPE TO HEAT TRANSFER STATION
SHUT-OFF VALVES FOR POTABLE AND NON-POTABLE WATER FEEDING SYSTEMS
NON POTABLE WATER PIPE TO GANTRY AREA
SHUT-OFF VALVES FOR POTABLE AND NON-POTABLE WATER FEEDING SYSTEMS
POTABLE/ NON POTABLE WATER PIPEWORK INSTALLED UNDERGROUND - PEHD
SHUT-OFF VALVES FOR POTABLE AND NON-POTABLE WATER FEEDING SYSTEMS
NON POTABLE WATER PIPE TO GANTRY AREA
VALVED PIT MECHANICAL SET UP FOR IRRIGATION
VALVED PIT MECHANICAL SET UP FOR IRRIGATION
VALVED PIT MECHANICAL SET UP FOR IRRIGATION